

12 x 4 CYLINDER

INSTALLATION INSTRUCTIONS

DIRECT RECESSED MOUNTING OUTLET BOX

ALL COMPONENTS SUPPLIED
BY THE KIRLIN COMPANY
UNLESS OTHERWISE SPECIFIED


SAFETY CABLE (OPTIONAL)

(REFERENCE)


OUTLET BOX
PROVIDED BY CONTRACTOR
(SHOWN WITH 4" OCTAGON
BOX FOR REFERNCE)

(2) OUTLET BOX SCREWS (PROVIDED BY CONTRACTOR)

<u>Ø12" x 4"</u> LUMINAIRE CYLINDER



FULLY ASSEMBLED (REFERENCE)




NOTE:
ONLY REMOVE
THE KEYWAY
GASKET NEEDED
FOR MOUNTING

DIRECT MOUNTING (Ø4" x 12" CYL.)
WILL MOUNT DIRECTLY TO THE
FOLLOWING STANDARD OUTLET
BOXES WITH A KEYWAY
OR HOLE PATTERN IN HOUSING:

4" OCTAGON 3-1/2" OCTAGON 4" SQUARE 4-11/16" SQUARE

VIEW OF WIRES IN THE JUNCTION BOX

OPTIONAL SAFETY CABLE **MUST** BE SECURED BY CONTRACTOR




ROUTE LUMINAIRE WIRES & SAFETY CABLE THRU CENTER HOLE & INTO OUTLET BOX.

<u>!!CAUTION!!</u> <u>DO NOT</u> BRING BUILDING WIRE INTO LUMINAIRE. LUMINAIRE LEADS <u>MUST</u>
TERMINATE IN OUTLET BOX MOUNTED
IN CEILING ABOVE AS SHOWN


INSTALL IN ACCORDANCE WITH ALL APPLICABLE NATIONAL AND LOCAL ELECTRIC CODES INSTALL IN ACCORDANCE WITH ALL MARKINGS APPEARING ON OR INSIDE LUMINAIRES



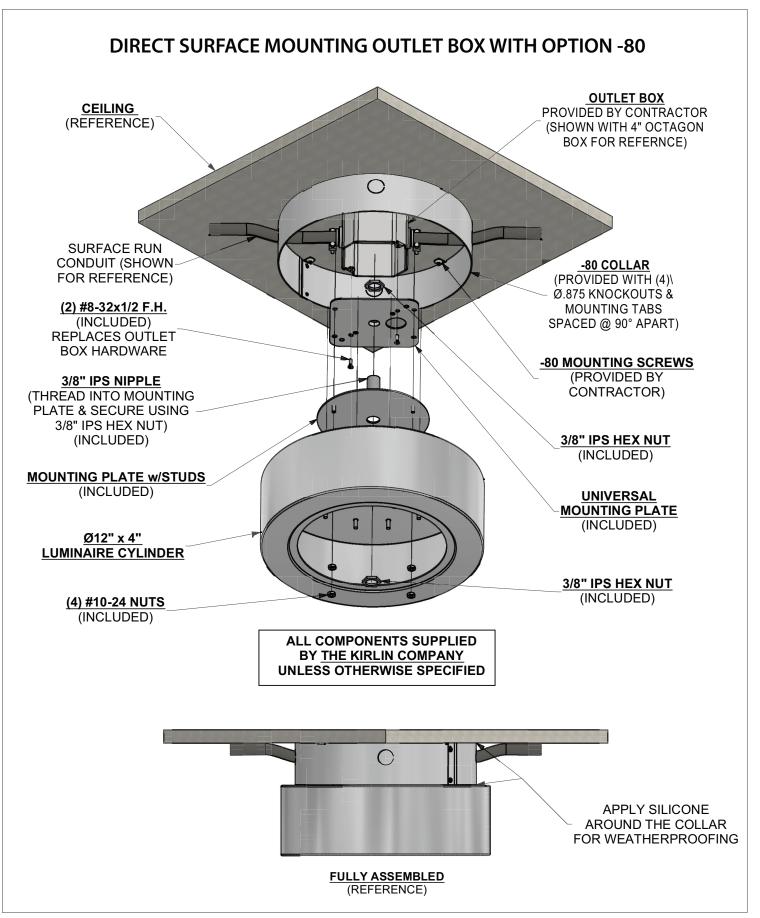

INSTALL IN ACCORDANCE WITH ALL APPLICABLE NATIONAL AND LOCAL ELECTRIC CODES INSTALL IN ACCORDANCE WITH ALL MARKINGS APPEARING ON OR INSIDE LUMINAIRES



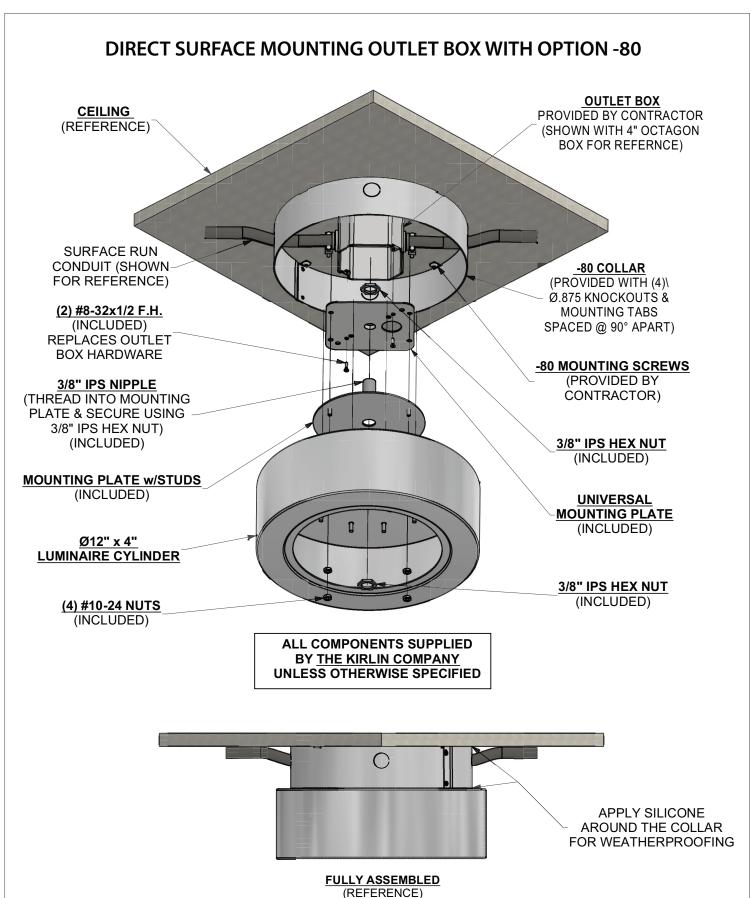

INSTALL IN ACCORDANCE WITH ALL APPLICABLE NATIONAL AND LOCAL ELECTRIC CODES INSTALL IN ACCORDANCE WITH ALL MARKINGS APPEARING ON OR INSIDE LUMINAIRES



